

TABLE OF CONTENTS

	PAGE
Introduction	3
Inspect Shipment	3
Things to Consider Before Installing Boiler	4
Boiler Room Air Requirements	6
Oil Supply Piping	10
Gas Supply Piping	13
Boiler Assembly and Installation	15
Jacket Attachment	16
Oil or Gas Burner Piping	18
Wiring.....	18
Burner Mounting	19
Filling Boiler	20
Burner Start-Up	20
Maintenance	21
Parts List with Exploded Drawing	22, 23


TABLE

1	Boiler Specification - Dimensio.....	2
2	Minimum Boiler Water Flo.....	8
3	Gas Pipe Capacity and Sizing	13
4	Burner Data	19

FIGURE

1	Typical Boiler Room Layout	5
2	Boiler Room Ventilation and Combustion Air	6
3	Chimney or Vent System	7
4,5,6	Typical Heating System Piping	8,9
7	Oil Line Sizing	11
8	Oil Burner Piping Diagrams	12
9	Gas Burner Piping Diagrams	14
10	Supply Manifold Assembly	15
11	Return/Diffuser Installation	15
12	Jacket Assembly	17
13	Boiler Acc. and Control Location	18
14	Parts Diagram	22

SPECIFICATIONS — DIMENSIONS TABLE 1

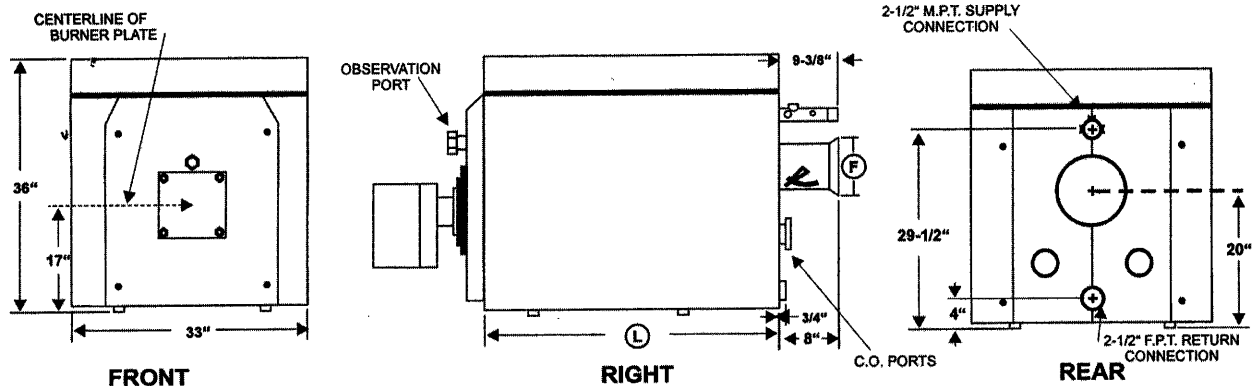

BOILER MODEL	I=B=R BURNER INPUT		I=B=R *GROSS OUTPUT		I=B=R **NET RATING WATER MBH	APPROX. DRY WEIGHT LBS.	VENT CONNECT. DIA. INCHES (F)	I=B=R VENT DIA. INCHES ***	DIM. INCHES (L)	WATER CONTENT GAL.	DRAFT LOSS IN. W.C.
	OIL GPH	GAS MBH	MBH	BHP							
FW-4	3.0	433	355	10.6	309	948	8	7	32	15.8	.16
FW-5	4.0	577	478	14.2	416	1124	8	7	37	19.0	.27
FW-6	5.0	722	600	17.9	522	1301	10	8	42	22.2	.39
FW-7	6.0	866	723	21.6	629	1477	10	9	47	25.4	.51
FW-8	7.5	1082	907	27.1	789	1654	10	10	52	28.5	.62
FW-9	9.0	1299	1091	32.6	949	1831	10	10	57	31.7	.75

Note: All dimensions are in inches

*Gross I=B=R rating has been determined under the I=B=R provisions governing forced draft conditions (0.10 inch W.C. positive pressure at the boiler flue gas outlet.

**Net ratings are based on piping and pickup allowance of 1.15.

*** I=B=R Vent Diameter size is the pipe size used from boiler vent connector (F) to Termination of stub stack: Max. Height 15' (For forced draft firing only).

For chimney venting consult National Fuel Gas Code.